

**Christchurch  
City Council**



**Christchurch Wastewater Treatment Plant  
Annual Monitoring Report  
July 2014 - June 2015**

CHRISTCHURCH WASTEWATER TREATMENT PLANT • SHUTTLE DRIVE OFF PAGES ROAD  
PO BOX 73041 • CHRISTCHURCH • NEW ZEALAND • TEL 64-3-941-5701 • FAX 64-3-941-5729

File: CRC051724 Annual Report For Ocean Outfall 2014-2015

Contact: Lee Liaw

## Summary

This report summarises the results of parameters monitored by the Christchurch Wastewater Treatment Plant (CWTP) over the period July 2014 – June 2015 in accordance with consent CRC051724. Consent CRC051724 allows the discharge of treated wastewater from the CWTP Oxidation Ponds into the Pegasus Bay Coastal Marine Area via an ocean outfall.

Of the comprehensive sampling programme required by the consents, all samples were collected during the monitoring period and most monitored parameters achieved the required standards. CWTP's replacement outlet structure from the plant to Pond 1 was operational from late 2014.

There was another exceedances of total suspended solids, and bacteria in the 2014/15 summer due to an overgrowth of algae caused by a combination of low flows into the plant and high temperatures.

A five-yearly visual inspection was done on the outfall, which was non-eventful.

# Christchurch Wastewater Treatment Plant Contents

## Annual Monitoring Report

Jul 2014 – Jun 2015

<b>1</b>	<b>OUTFALL DISCHARGE .....</b>	<b>4</b>
1.1	Resource Consent Conditions.....	4
1.2	Comments on Resource Consent Conditions .....	4
1.3	Resource Consent Standard Conditions.....	6
1.4	Comments on Resource Consent Standard Conditions .....	6
1.5	Dissolved BOD <sub>5</sub> Compliance .....	7
1.6	Total Suspended Solids Compliance .....	8
1.7	Ammonia Nitrogen Compliance.....	9
1.8	Enterococci Monitoring.....	10
1.9	Faecal Coliform Compliance.....	11
1.10	Other Pathogenic, and Other Contaminants .....	12
<b>2</b>	<b>RECEIVING ENVIRONMENT MONITORING IN PEGASUS BAY .....</b>	<b>13</b>
2.1	Water Quality Resource Consent Conditions .....	13
2.2	Comments on Compliance.....	14
2.3	Beach Water Quality Analysis Results.....	14
2.4	Other Receiving Environment Analysis.....	15
2.5	Comments on Other Receiving Environment .....	16

# 1 Outfall Discharge

## 1.1 Resource Consent Conditions

Table 1.1.1 Pond Discharge Consent Compliance for Monitoring Period July 2014 – June 2015 CRC051724

Consent Condition	Parameter	Compliance Condition	Compliance												
			Jul-14	Aug-14	Sep-14	Oct-14	Nov-14	Dec-14	Jan-15	Feb-15	Mar-15	Apr-15	May-15	Jun-15	Overall
2	Discharge Content	Discharge is only wastewater from the CWTP ponds	J	J	J	J	J	J	J	J	J	J	J	J	J
3	Discharge Volume	Recorded	J	J	J	J	J	J	J	J	J	J	J	J	J
4	Discharge Rate	Recorded	J	J	J	J	J	J	J	J	J	J	J	J	J
9	Outfall Maintenance	Routine maintenance completed and recorded	J	J	J	J	J	J	J	J	J	J	J	J	J
10	Outfall Condition	Visual inspection of outfall	n/a	n/a	n/a	n/a	n/a	n/a	n/a	J	n/a	n/a	n/a	n/a	J
12	Pumping Pressure for a given flow	Monitored	J	J	J	J	J	K	J	J	J	J	J	J	J


Key: J Full Compliance    K Minor, Isolated or Risk of Non-Compliance    L Major or Consistent Non-Compliance

## 1.2 Comments on Resource Consent Conditions


The Ocean Outfall Pumping Station has operated within expected parameters and is comparable with last year's performance. The discharge flows and pressures were recorded as noted in the quarterly reports.

Visual inspection and cleaning of the outfall diffuser was completed February 2015, and the report was forwarded to ECan.

**Figure 1.2.1 - Daily Outfall Flow Totals Jul 2014 – Jun 2015**

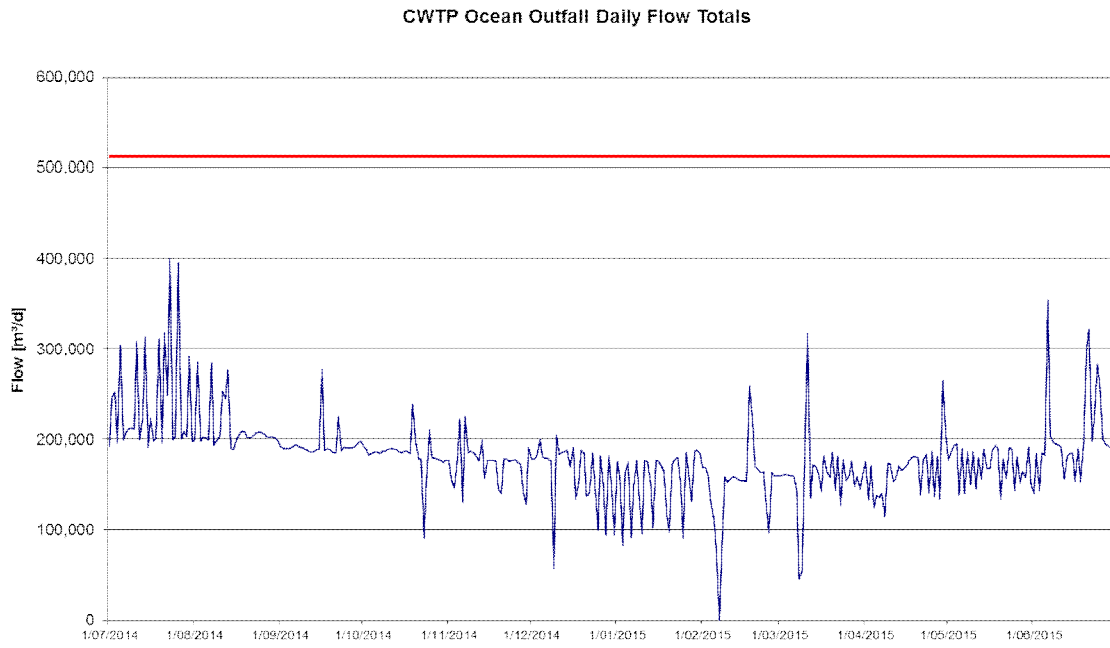

**Figure 1.2.2 - Daily Peak Outfall Flows Jul 2014 - Jun 2015**

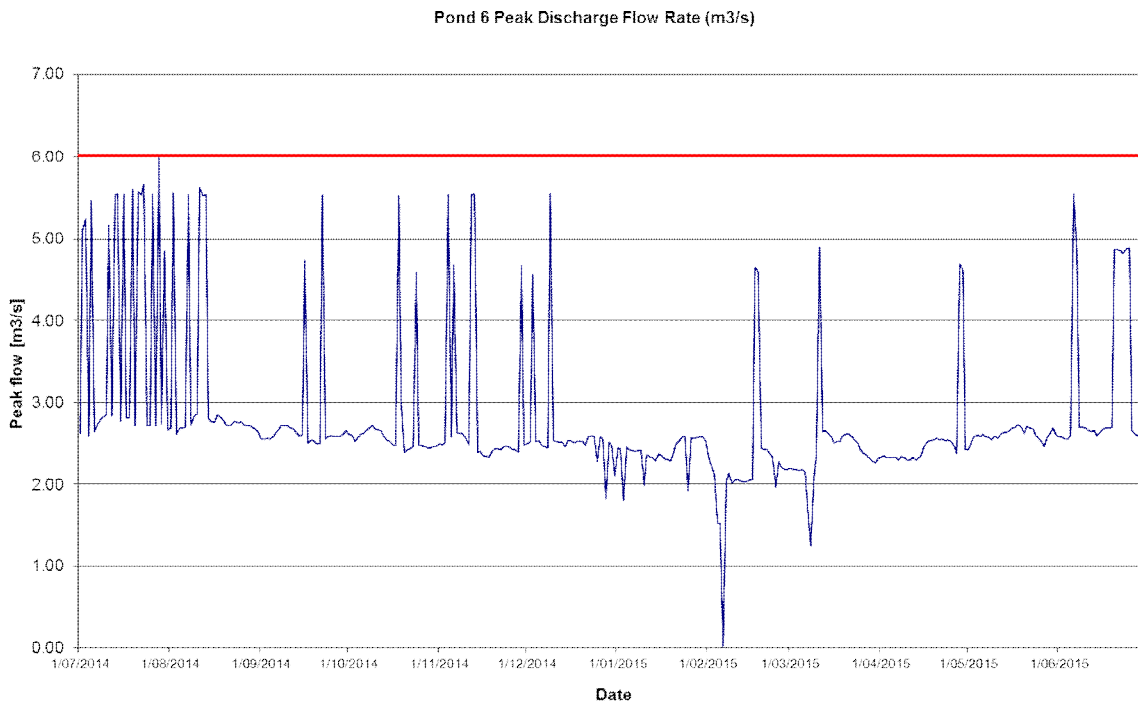

### 1.3 Resource Consent Standard Conditions

Table 1.3.1 Contaminant Limits Consent Compliance Jul 2014 – Jun 2015 CRC051724

Consent Condition	Parameter	Compliance Condition	Compliance														
			Jul-14	Aug-14	Sep-14	Oct-14	Nov-14	Dec-14	Jan-15	Feb-15	Mar-15	Apr-15	May-15	Jun-15	Overall		
15a	Dissolved BOD <sub>5</sub>	Concentration does not exceed 20 g/m <sup>3</sup>	J	J	J	J	J	J	J	J	J	J	J	J	J		
	Total Suspended Solids	Concentration does not exceed 50 g/m <sup>3</sup>	J	J	J	J	J	J	J	J	K	K	K	K	J	K	
	Ammoniacal Nitrogen	Concentration does not exceed 40 g/m <sup>3</sup>	J	J	J	J	J	J	J	J	J	J	J	J	J	J	
16a	Faecal Coliforms	Concentration does not exceed 1,000(standard)/5,000(higher) MPN/100mL	J	J	J	J	J	J	J	J	J	K	J	K	J	J	K
	Enterococci	Concentration does not exceed 1,500 MPN/100mL	J	J	J	J	J	J	J	J	J	J	K	J	J	J	J

Key: J Compliance Achieved with no Exceedance of Standard    K Compliance Achieved with Occasional Exceedance of Standard    L Exceedance of Standard resulting in Non-Compliance

### 1.4 Comments on Resource Consent Standard Conditions

There was an algae growth during the 2014/15 summer that had a detrimental effect on the plant's total suspended solids, enterococci and faecal coliform results.


## 1.5 Dissolved BOD<sub>5</sub> Compliance

**Table 1.5.1** Pond Discharge Dissolved BOD<sub>5</sub>

Median Value [g/m <sup>3</sup> ] Current Monitoring Period (July 2014 - June 2015)	2.5	Number of Exceedances Current Monitoring Period (July 2014 - June 2015)	0
Median Value [g/m <sup>3</sup> ] Previous Monitoring Period (July 2013 - June 2014)	1.8	Number of Exceedances Previous Monitoring Period (July 2013 - June 2014)	0

There were no values exceeding the 20g/m<sup>3</sup> limit recorded for the current year. The mean value for the current reporting period was higher than the previous period.

### 1.5.2 Pond Discharge Dissolved BOD<sub>5</sub>

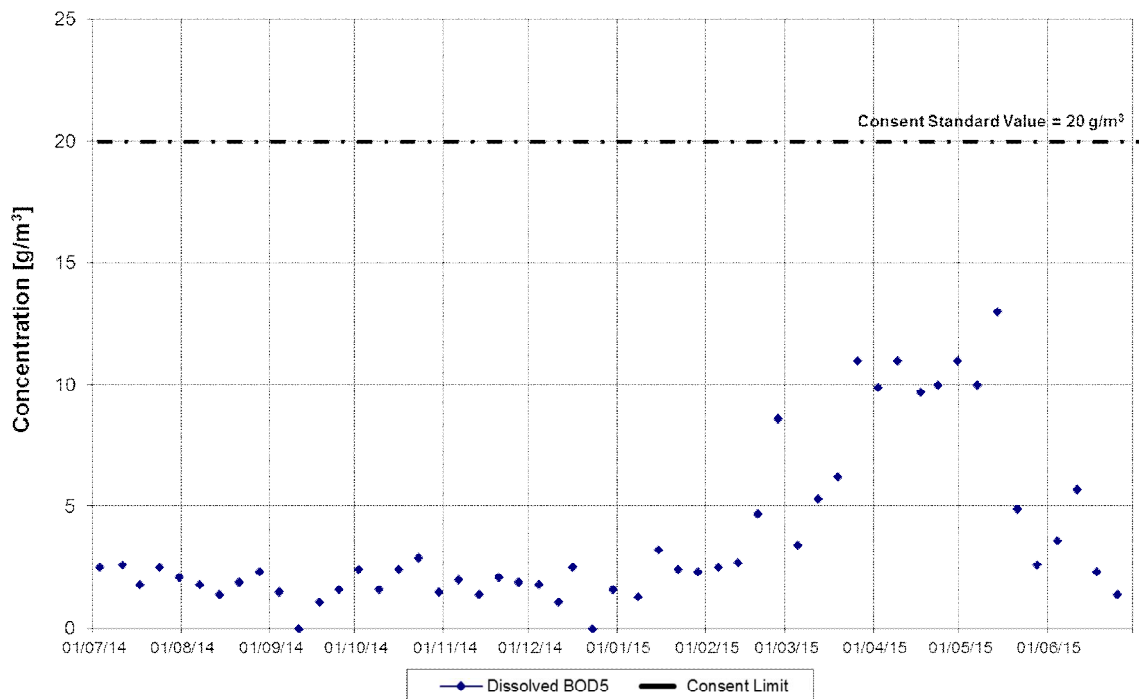


## 1.6 Total Suspended Solids Compliance

**Table 1.6.1** Pond Discharge Total Suspended Solids

Median Value [g/m <sup>3</sup> ] Current Monitoring Period (July 2014 - June 2015)	18.5	Number of Exceedances Current Monitoring Period (July 2014 - June 2015)	13
Median Value [g/m <sup>3</sup> ] Previous Monitoring Period (July 2013 - June 2014)	7	Number of Exceedances Previous Monitoring Period (July 2013 - June 2014)	0

There were 13 exceedances recorded for the current year, due to high temperatures and low flows contributing to an algae increase. The median value for the current period was higher than the previous reporting period.

**1.6.2** Pond Discharge Total Suspended Solids

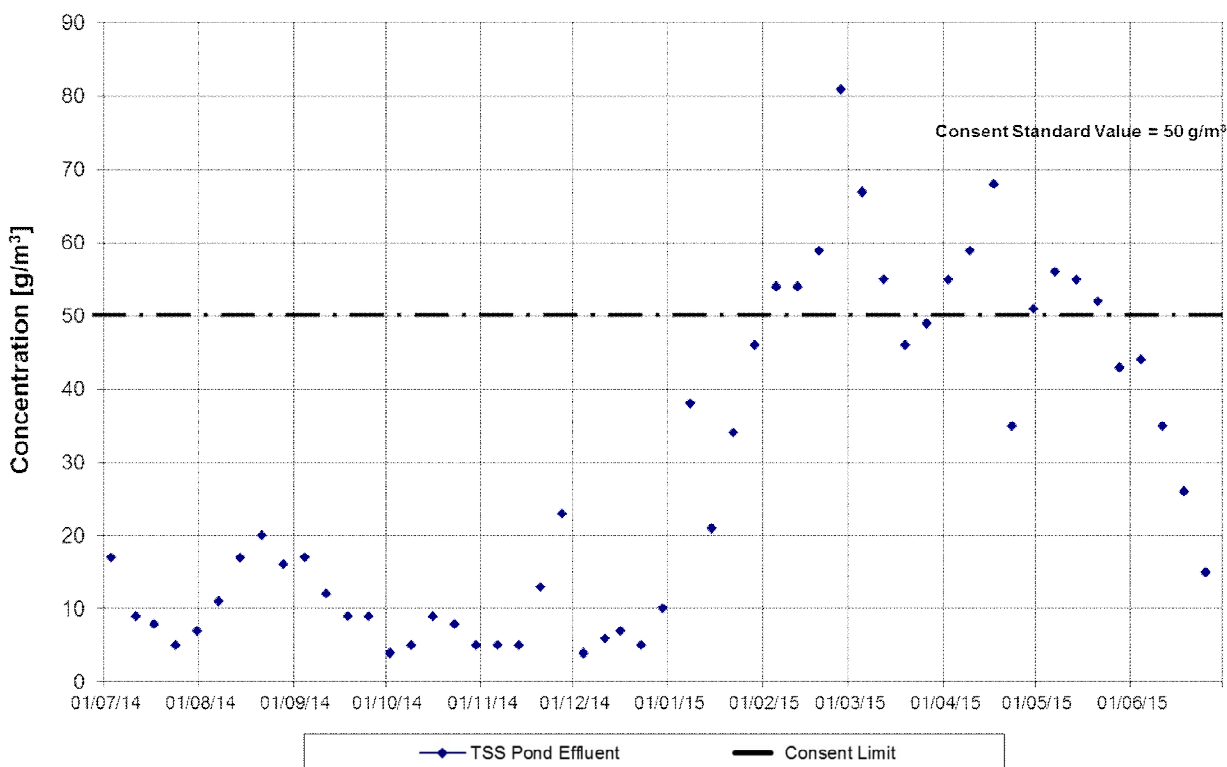




## 1.7 Ammonia Nitrogen Compliance

**Table 1.7.1** Pond Discharge Ammoniacal Nitrogen

Median Value [g/m <sup>3</sup> ] Current Monitoring Period (July 2014 - June 2015)	22	Number of Exceedances Current Monitoring Period (July 2014 - June 2015)	0
Median Value [g/m <sup>3</sup> ] Previous Monitoring Period (July 2013 - June 2014)	20	Number of Exceedances Previous Monitoring Period (July 2013 - June 2014)	0

There were no exceedances recorded for current year. The mean value for the current period were higher than the previous reporting period.

**1.7.1** Pond Discharge Ammoniacal Nitrogen

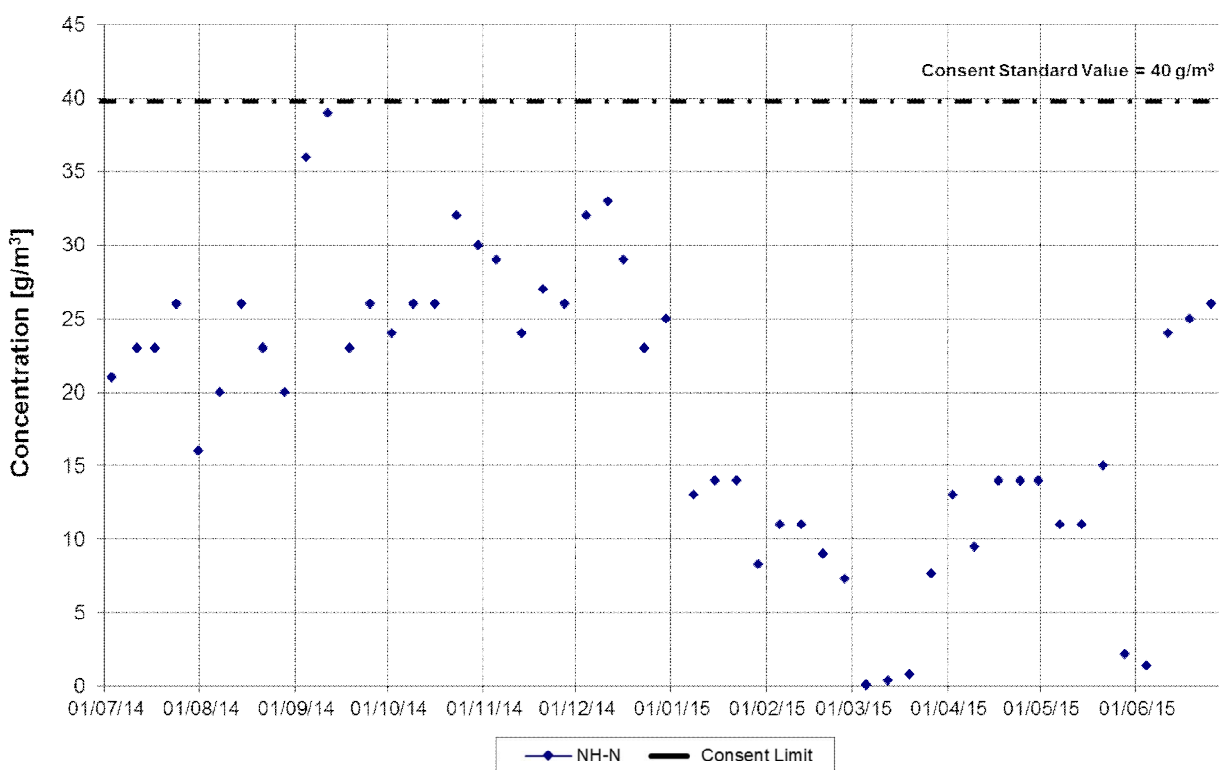


## 1.8 Enterococci Monitoring

Table 1.8.1 Pond Discharge Enterococci

Median Value [MPN/100ml] Current Monitoring Period (July 2014 - June 2015)	63	Number of Exceedances Current Monitoring Period (July 2014 - June 2015)	3
Median Value [MPN/100ml] Previous Monitoring Period (July 2013 - June 2014)	90	Number of Exceedances Previous Monitoring Period (July 2013 - June 2014)	2

There were three exceedances of the consented value in the current year due to algae growth reducing the efficiency of disinfection. The mean value was lower than the previous period.

1.8.1 Pond Discharge Enterococci

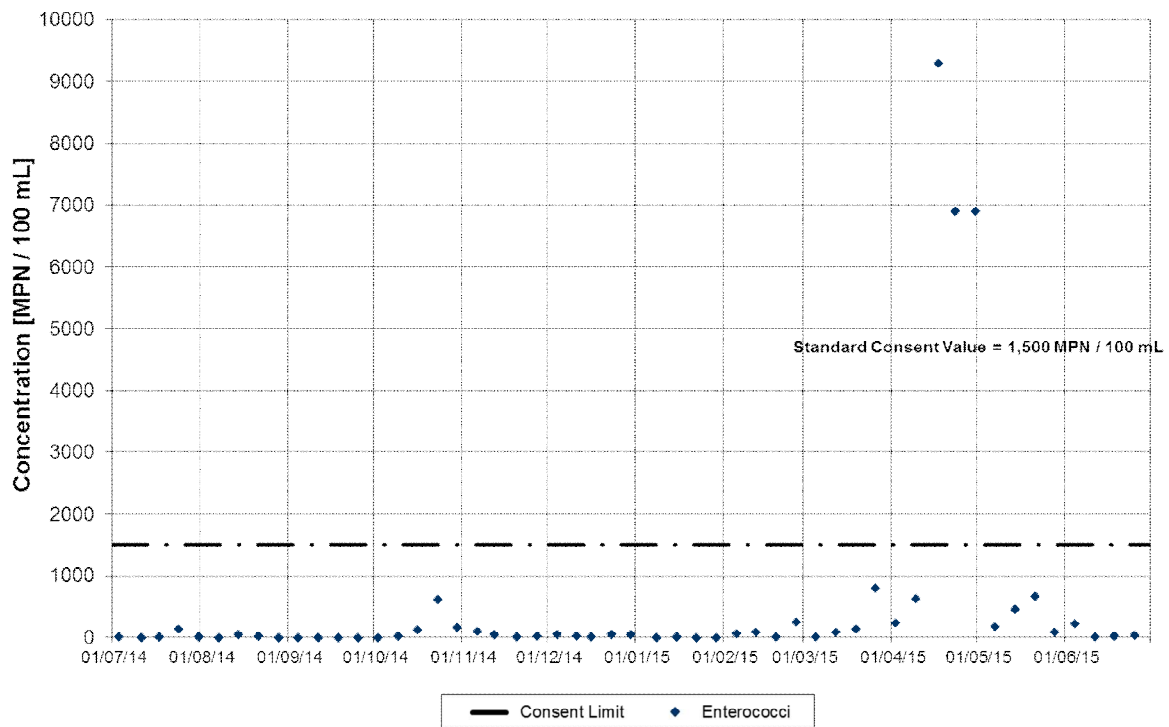


## 1.9 Faecal Coliform Compliance

**Table 1.9.1** Pond Discharge Faecal Coliforms

Median Value [MPN/100ml] Current Monitoring Period (July 2014 - June 2015)	120	Number of Exceedances of Lower Limit Current Monitoring Period (July 2014 - June 2015)	3
Median Value [MPN/100ml] Previous Monitoring Period (July 2013 - June 2014)	90	Number of Exceedances of Lower Limit Previous Monitoring Period (July 2013 - June 2014)	2

There were three non-compliance samples due to algae growth reducing the efficiency of disinfection. The median for this year is higher than the previous period.

### 1.9.1 Pond Discharge Faecal Coliforms

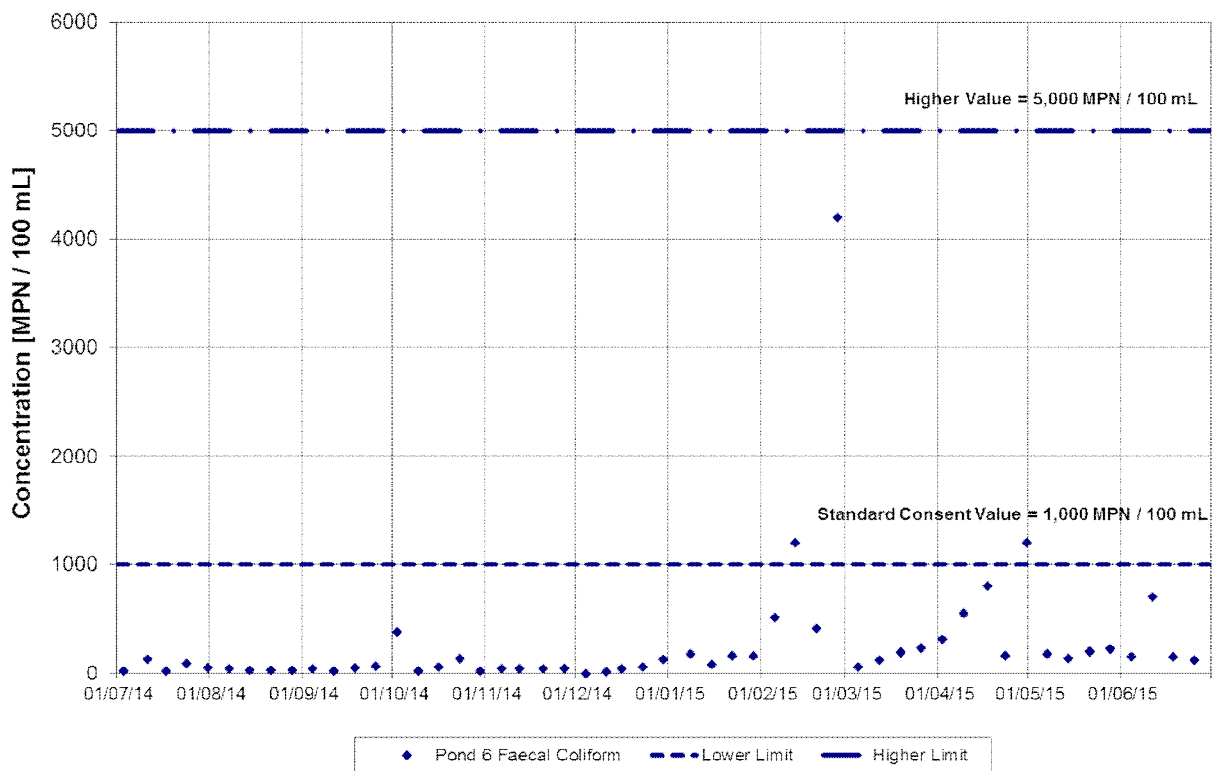

## 1.10 Other Pathogenic, and Other Contaminants

### Condition 13e

Giardia cysts, cryptosporidium, salmonella, enterovirus, adenovirus and campylobacter levels have been measured and reported in March 2015

### Condition 13f

Heavy metals (copper, chromium, nickel, zinc, cadmium, lead, arsenic, and mercury) were measured and reported July 2013, December 2014 and April 2015.

### Condition 13g

Organochlorine pesticides, organophosphate pesticides, PCBs, and polycyclic aromatic hydrocarbons were measured and reported February 2015.

### Condition 17

No scums, foams or other floatable material was observed at the edge of the diffuser mixing zone during the March 2015 survey.

## 2 Receiving Environment Monitoring in Pegasus Bay

### 2.1 Water Quality Resource Consent Conditions

Table 2.1.1 Receiving Environment Water Quality Consent Compliance July 2014 – June 2015

Consent Condition	Parameter	Compliance Condition	Compliance				
			Jul - Oct 14	Nov –Jan 15	Feb – Apr 15	May - Jun 15	Overall
18	Faecal Coliforms	Sampled and Analysed	J	J	J	J	J
	Enterococci	Sampled and Analysed	J	J	J	J	J
22a <sup>1</sup>	Temperature	Two yearly	n/a	n/a	J	n/a	n/a
	DO	Two yearly	n/a	n/a	J	n/a	n/a
	Salinity	Two yearly	n/a	n/a	J	n/a	n/a
	Total Suspended Solids	Two yearly	n/a	n/a	J	n/a	n/a
	Nitrogen Oxides	Two yearly	n/a	n/a	J	n/a	n/a
	Ammoniacal Nitrogen	Two yearly	n/a	n/a	J	n/a	n/a
	Dissolved Reactive Phosphorus	Two yearly	n/a	n/a	J	n/a	n/a
	Chlorophyll-a	Two yearly	n/a	n/a	J	n/a	n/a
	Trace Metals (arsenic, cadmium, copper, chromium, lead, nickel and zinc)	Two yearly	n/a	n/a	J	n/a	n/a
	Faecal Coliforms	Two yearly	n/a	n/a	J	n/a	n/a
	Enterococci	Two yearly	n/a	n/a	J	n/a	n/a
	Phytoplankton Species	Two yearly	n/a	n/a	J	n/a	n/a

Key: J Full Compliance    K Minor, Isolated or Risk of Non-Compliance    L Major or Consistent Non-Compliance

<sup>1</sup> Sampling is scheduled for 2013.

## 2.2 Comments on Compliance


Most results for the Pegasus Bay area were within consent for 2014-15. Any tests that failed initial sampling passed on their 24hr delayed sample.

Testing for condition 22a was done February 2015 and reported to ECan.


## 2.3 Beach Water Quality Analysis Results

Samples for condition 18 were taken at weekly intervals from the prescribed onshore locations. The results are presented in Figures 2.3.1 and 2.3.2. Retest results are contained in the appendices.

### 2.3.1 Enterococci Levels at beaches adjacent to the Outfall

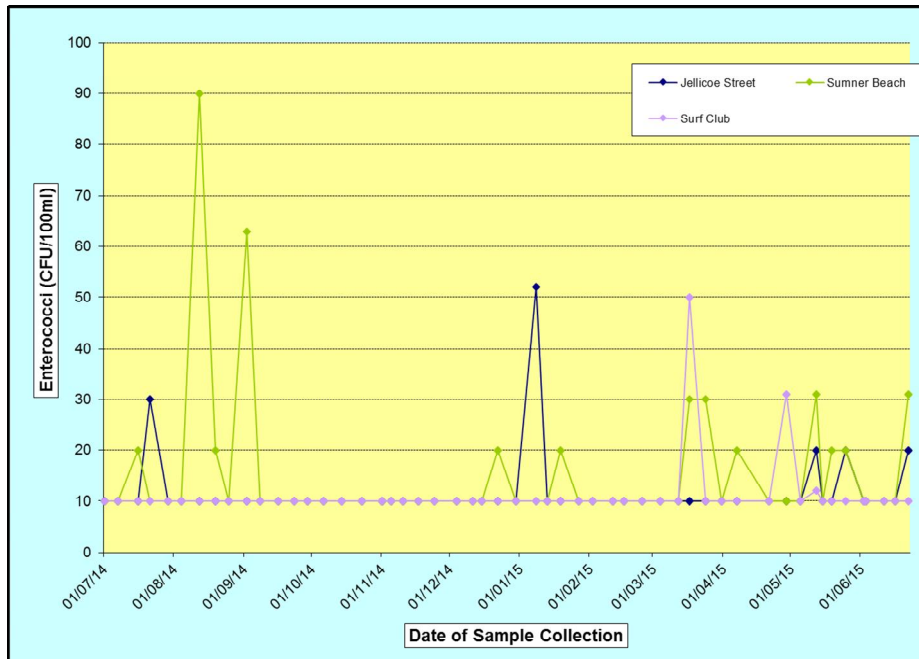

### 2.3.2 Faecal Coliform Levels at beaches adjacent to the Outfall

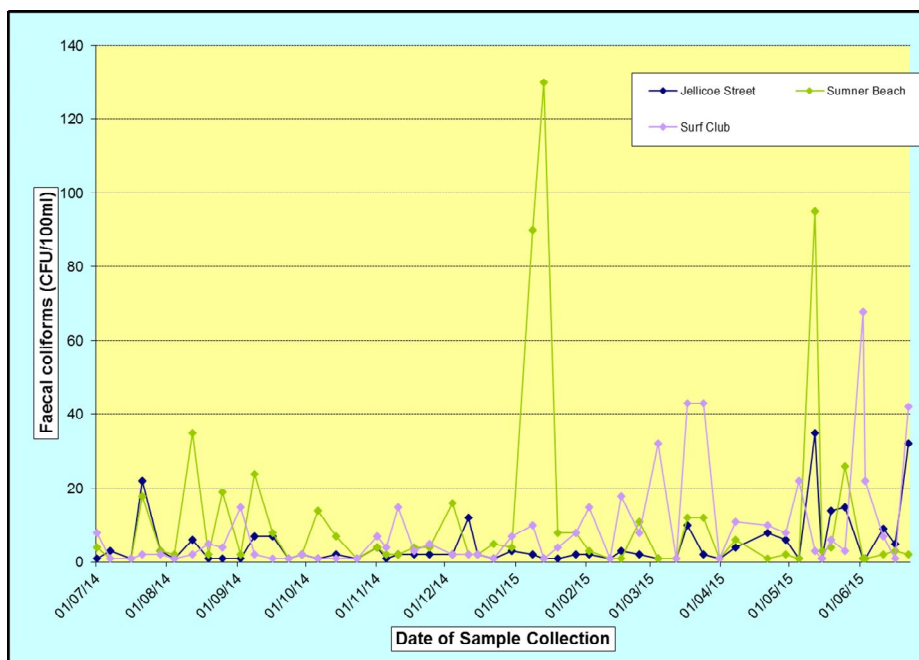

## 2.4 Other Receiving Environment Analysis

Consent conditions 23, 25, 26 and 27 call for monitoring of the marine environment around the outfall at various frequencies and were identified in the AEE. These requirements are summarised in Table 2.4.1. The results are attached to the quarterly reports covering the same period.

**Table 2.4.1** Receiving Environment Monitoring Consent Compliance Jul 2014 - Jun 2015

Consent Condition	Parameter	Frequency	Compliance Condition	Compliance				
				Jul - Oct 14	Nov –Jan 15	Feb – Apr 15	May - Jun 15	Overall
23	Marine Sediments	5-yearly	Reported	n/a	n/a	n/a	n/a	n/a
25	Benthic Invertebrates	5-yearly	Reported	n/a	n/a	n/a	n/a	n/a
26	Epibenthic Fauna	5-yearly	Reported	n/a	n/a	n/a	n/a	n/a
27	Shellfish/Tuatua	Quarterly	Sampled and Analysed	J	J	J	J	J
29	Complaints	As required	Recorded and Reported	J	J	J	J	J
31	Report	Annually	Report and information lodged with ECan	J	n/a	n/a	n/a	J
32	Report	Quarterly	Report and information lodged with ECan	J	J	J	J	J
34	Management Plan	4 Years post commissioning	Report and information lodged with ECan	n/a	n/a	n/a	n/a	n/a
36	Community Liaison Group	Annually	Recorded and Reported	n/a	J	n/a	n/a	n/a

Key: J Full Compliance    K Minor, Isolated or Risk of Non-Compliance    L Major or Consistent Non-Compliance

## **2.5 Comments on Other Receiving Environment**

### Conditions 23 - 26

Sediment, benthic and epibenthic testing is due in 2016.

### Condition 27

Shellfish were sampled and analysed.

### Condition 29

There were no complaints from the public regarding the ocean outfall during the reporting period.

### Condition 31 and 32

Annual and quarterly reports have been submitted to ECan.

### Condition 36

The community liaison meeting was held 12/11/14 at CWTP.